

Смесители термостатические ВР 3950, 3956, 3957, 3956VR

Технические характеристики

По вопросам продаж и поддержки обращайтесь:

Алматы (7273)495-231
Ангарск (3955)60-70-56
Архангельск (8182)63-90-72
Астрахань (8512)99-46-04
Барнаул (3852)73-04-60
Белгород (4722)40-23-64
Благовещенск (4162)22-76-07
Брянск (4832)59-03-52
Владивосток (423)249-28-31
Владикавказ (8672)28-90-48
Владимир (4922)49-43-18
Волгоград (844)278-03-48
Вологда (8172)26-41-59
Воронеж (473)204-51-73
Екатеринбург (343)384-55-89

Иваново (4932)77-34-06
Ижевск (3412)26-03-58
Иркутск (395)279-98-46
Казань (843)206-01-48
Калининград (4012)72-03-81
Калуга (4842)92-23-67
Кемерово (3842)65-04-62
Киров (8332)68-02-04
Коломна (4966)23-41-49
Кострома (4942)77-07-48
Краснодар (861)203-40-90
Красноярск (391)204-63-61
Курск (4712)77-13-04
Курган (3522)50-90-47
Липецк (4742)52-20-81

Магнитогорск (3519)55-03-13
Москва (495)268-04-70
Мурманск (8152)59-64-93
Набережные Челны (8552)20-53-41
Нижний Новгород (831)429-08-12
Новокузнецк (3843)20-46-81
Ноябрьск (3496)41-32-12
Новосибирск (383)227-86-73
Омск (3812)21-46-40
Орел (4862)44-53-42
Оренбург (3532)37-68-04
Пенза (8412)22-31-16
Петрозаводск (8142)55-98-37
Псков (8112)59-10-37
Пермь (342)205-81-47

Ростов-на-Дону (863)308-18-15
Рязань (4912)46-61-64
Самара (846)206-03-16
Санкт-Петербург (812)309-46-40
Саратов (845)249-38-78
Севастополь (8692)22-31-93
Саранск (8342)22-96-24
Симферополь (3652)67-13-56
Смоленск (4812)29-41-54
Сочи (862)225-72-31
Ставрополь (8652)20-65-13
Сургут (3462)77-98-35
Сыктывкар (8212)25-95-17
Тамбов (4752)50-40-97
Тверь (4822)63-31-35

Тольятти (8482)63-91-07
Томск (3822)98-41-53
Тула (4872)33-79-87
Тюмень (3452)66-21-18
Ульяновск (8422)24-23-59
Улан-Удэ (3012)59-97-51
Уфа (347)229-48-12
Хабаровск (4212)92-98-04
Чебоксары (8352)28-53-07
Челябинск (351)202-03-61
Череповец (8202)49-02-64
Чита (3022)38-34-83
Якутск (4112)23-90-97
Ярославль (4852)69-52-93

Россия +7(495)268-04-70

Казахстан +7(7172)727-132

Киргизия +996(312)96-26-47

эл.почта: fro@nt-rt.ru || сайт: <https://far.nt-rt.ru/>

THERMOSTATIC MIXER FOR DOMESTIC SERVICES

ART.3950
1/2" - 3/4" - 1"



ART.3956
1/2" - 3/4" - 1" - *1 1/4" - *1 1/2"



* For technical information relating to these measures view the technical sheet: ST.01.33

ART.3957
3/4" - 1"



ART.3956VR
1/2" - 3/4" - 1"



NON-RETURN VALVE ON
SIDE CONNECTIONS

TERMOFAR - thermostatic mixer for domestic services

- Setting range: 30÷65°C
- Max. input temperature: 95°C
- TEA®PLUS surface treatment on the inside and outside

1 DESCRIPTION

The TERMO-FAR mixer is designed to maintain a constant preset temperature for the mixed water sent to the domestic services.

This device avoids the accidental use of very hot water, that might cause scalding, there is the anti-scald feature, which stops the hot flow in case of absence of cold water.

2 CONSTRUCTION AND OPERATIONS DETAILS

The mixer is equipped with a thermo-sensitive element, which detects the temperature of the mixed fluid. The sensor is directly immersed into the mixed water, permitting maximum accuracy and speed of response. The sensor continuously monitors changes in water temperature and adjusts cold and hot water inlets to achieve the correct proportions of each and thus the set temperature.



N.B. in order to increase mixer accuracy it is essential to balance pressure between cold and hot water inlets.

SCREW FOR LOCKING


Once the handle is set at the desired temperature it is possible to lock it by pressing the screw

GRADUATED HANDLE

Valve calibration, i.e. setting the temperature of the water exiting the mixing valve, is carried out manually by turning the graduated handle

- HOT -
HOT WATER
INLET

- COLD -
COLD WATER
INLET

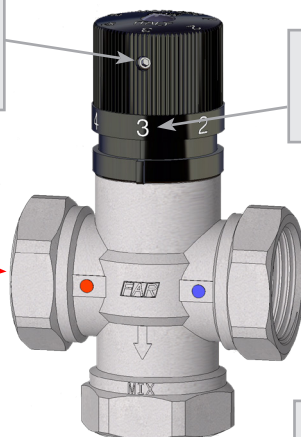

- MIX -
MIXED WATER
OUTLET

RECOMMENDED TEMPERATURES

To prevent scalds, the recommended temperatures for water leaving the taps are as follows:

USERS	MAX. TEMPERATURE
BIDET	38°C
WASHBASIN	40°C
SHOWER	40°C
BATH	44°C

MIXER CALIBRATION


The mixer is calibrated in our factory with hot water at 65°C and with cold water at 15°C at a pressure of 3 bar.

POSITION	TEMPERATURE
MIN	30°C
1	35°C
2	40°C
3	45°C
4	55°C
5	60°C
MAX	65°C


3 INSTALLATION

- Before the installation carefully clean the pipes to remove any sand, metal shavings and rust flakes in order to guard against any blockage of the shutter.
- Installation of strainers is recommended to keep the system free of impurities, which could impair mix operation.
- In systems with thermostatic mixers it is necessary to install non-return valves to avoid undesirable back flow. Moreover, if the hydraulic network has a pressure higher than 5 bar, a pressure reducing valve must be installed.
- The mixer can be installed in any position.
- During installation it is important to match the connection as shown on mixer body: HOT for hot water supply; COLD for cold water supply and MIX for mixed water outlet

INSTALLATION EXAMPLE

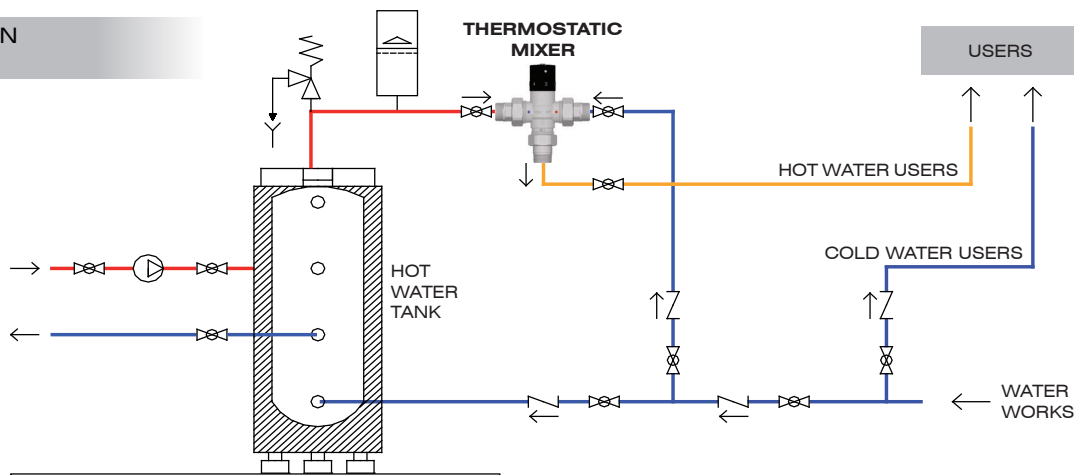

4 FLUID DYNAMIC FEATURES

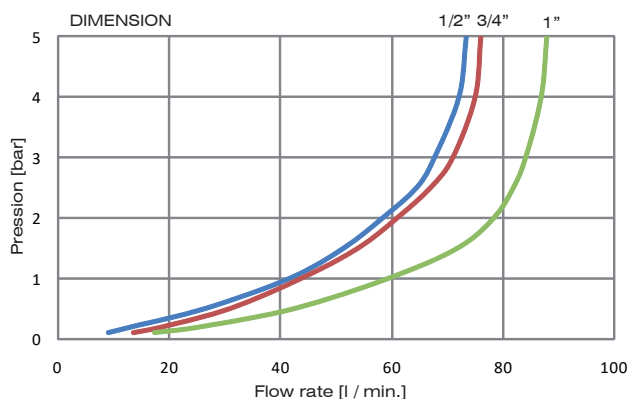


1/2" = 2.5 m³/h 3/4" = 2.9 m³/h 1" = 3 m³/h

1/2"VR = 1.6 m³/h 3/4"VR = 2.1 m³/h 1"VR = 2.3 m³/h

5 TECHNICAL FEATURES


Max. working pressure: 10 bar
 Recommended pressure: 1-5 bar
 Max. differential pressure: 3 bar
 Max. hot water temperature: 95°C
 Mixer body: Brass CW617N
 Min. flow rate:

6 DIMENSIONAL FEATURES

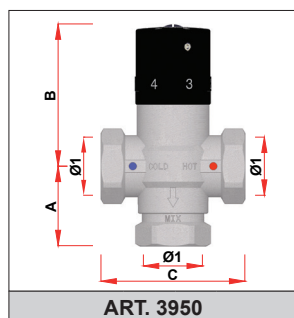


ART. 3950

CODE	Ø1	A	B	C
3950 12	1/2"	38	75	66
3950 34	3/4"	39	75	70
3950 1	1"	42	75	74

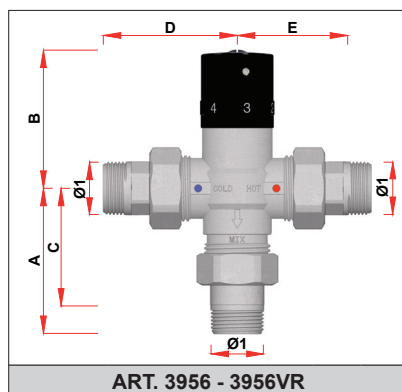

ART. 3956 - 3956VR

CODE	Ø1	A	B	C	D	E
3956 12	1/2"	69	75	56	64	51
3956 34	3/4"	72	75	60	68	56
3956 1	1"	78	75	62	74	58



ART. 3957

CODE	Ø1	A	B	C
3957 34	3/4"	38	75	66
3957 1	1"	39	75	70

По вопросам продаж и поддержки обращайтесь:

Алматы (7273)495-231
Ангарск (3955)60-70-56
Архангельск (8182)63-90-72
Астрахань (8512)99-46-04
Барнаул (3852)73-04-60
Белгород (4722)40-23-64
Благовещенск (4162)22-76-07
Брянск (4832)59-03-52
Владивосток (423)249-28-31
Владикавказ (8672)28-90-48
Владимир (4922)49-43-18
Волгоград (844)278-03-48
Вологда (8172)26-41-59
Воронеж (473)204-51-73
Екатеринбург (343)384-55-89

Иваново (4932)77-34-06
Ижевск (3412)26-03-58
Иркутск (395)279-98-46
Казань (843)206-01-48
Калининград (4012)72-03-81
Калуга (4842)92-23-67
Кемерово (3842)65-04-62
Киров (8332)68-02-04
Коломна (4966)23-41-49
Кострома (4942)77-07-48
Краснодар (861)203-40-90
Красноярск (391)204-63-61
Курск (4712)77-13-04
Курган (3522)50-90-47
Липецк (4742)52-20-81

Магнитогорск (3519)55-03-13
Москва (495)268-04-70
Мурманск (8152)59-64-93
Набережные Челны (8552)20-53-41
Нижний Новгород (831)429-08-12
Новокузнецк (3843)20-46-81
Ноябрьск (3496)41-32-12
Новосибирск (383)227-86-73
Омск (3812)21-46-40
Орел (4862)44-53-42
Оренбург (3532)37-68-04
Пенза (8412)22-31-16
Петрозаводск (8142)55-98-37
Псков (8112)59-10-37
Пермь (342)205-81-47

Ростов-на-Дону (863)308-18-15
Рязань (4912)46-61-64
Самара (846)206-03-16
Санкт-Петербург (812)309-46-40
Саратов (845)249-38-78
Севастополь (8692)22-31-93
Саранск (8342)22-96-24
Симферополь (3652)67-13-56
Смоленск (4812)29-41-54
Сочи (862)225-72-31
Ставрополь (8652)20-65-13
Сургут (3462)77-98-35
Сыктывкар (8212)25-95-17
Тамбов (4752)50-40-97
Тверь (4822)63-31-35

Тольятти (8482)63-91-07
Томск (3822)98-41-53
Тула (4872)33-79-87
Тюмень (3452)66-21-18
Ульяновск (8422)24-23-59
Улан-Удэ (3012)59-97-51
Уфа (347)229-48-12
Хабаровск (4212)92-98-04
Чебоксары (8352)28-53-07
Челябинск (351)202-03-61
Череповец (8202)49-02-64
Чита (3022)38-34-83
Якутск (4112)23-90-97
Ярославль (4852)69-52-93

Россия +7(495)268-04-70

Казахстан +7(7172)727-132

Киргизия +996(312)96-26-47

эл.почта: fro@nt-rt.ru || сайт: <https://far.nt-rt.ru/>